TRACER WIRE ACCESS BOX

NOTES

1. REFER TO STANDARD SPECIFICATIONS FOR TRACER WIRE.

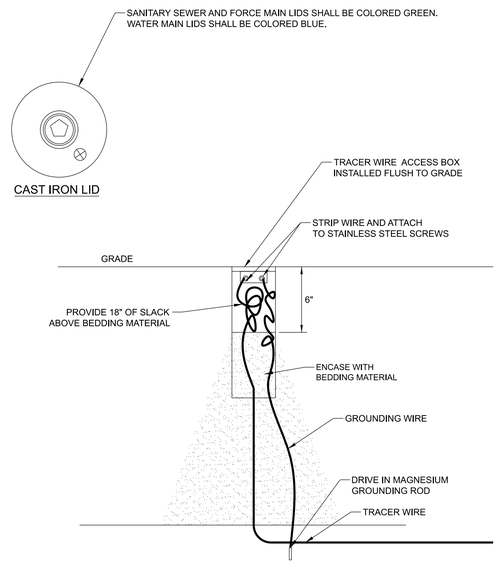

TRACER WIRE INSTALLATION ON SANITARY SEWER

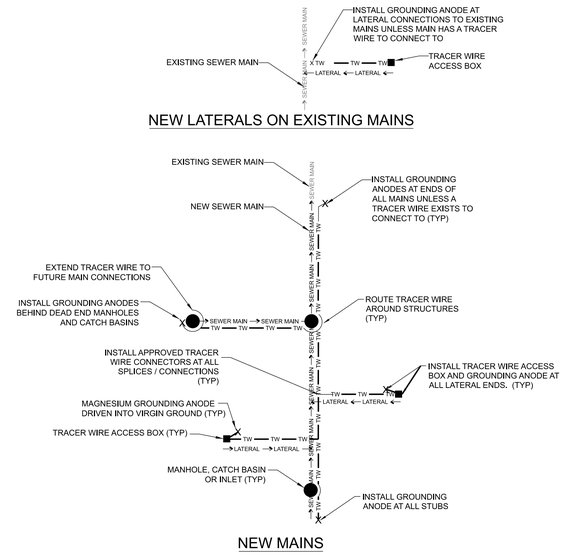

NOTES:

1. REFER TO SPECIFICATIONS FOR TRACER WIRE.
2. TRACER WIRE SHALL BE TAPED TO MAIN AND LATERALS. WIRE IS SHOWN OFF MAIN AND LATERALS FOR CLARITY.
3. RUN GROUND WIRE DOWN RISERS IF APPLICABLE.

TRACER WIRE INSTALLATION ON WATER MAIN

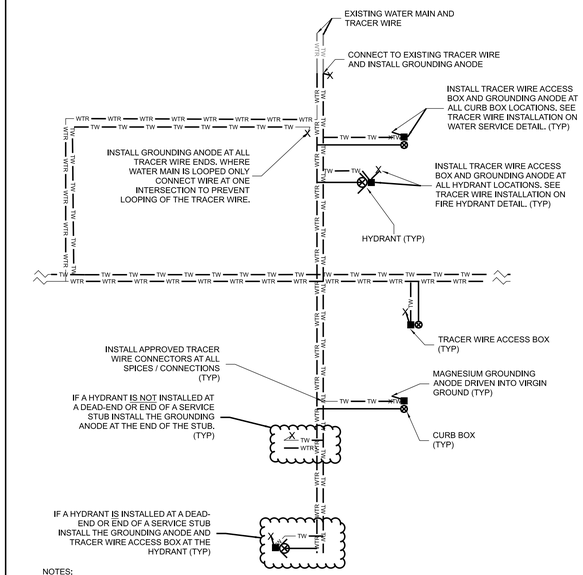

NOTES:

1. REFER TO SPECIFICATIONS FOR TRACER WIRE.
2. CONNECT TO EXISTING TRACER WIRE AT ONLY ONE LOCATION UNLESS OTHERWISE DIRECTED BY KWU.
3. TRACER WIRE SHALL BE TAPED TO MAIN AND SERVICES. WIRE IS SHOWN OFF PIPES FOR CLARITY.
4. LOOPING OF TRACER WIRE IS PROHIBITED.

TRACER WIRE INSTALLATION ON FIRE HYDRANT

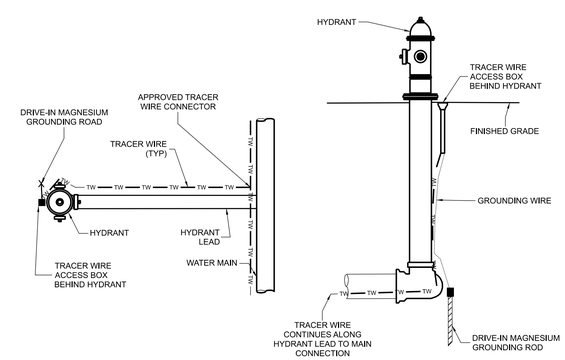

NOTES:

1. REFER TO SPECIFICATIONS FOR TRACER WIRE.
2. TRACER WIRE SHALL BE TAPED TO MAIN, LEAD AND HYDRANT. WIRE IS SHOWN OFF PIPES FOR CLARITY.
3. INSTALL GROUNDING ANODE BY DRIVING INTO VIRGIN GROUND AT THE HYDRANT SHOE.
4. TRACER WIRE ACCESS BOX SHALL BE INSTALLED DIRECTLY BEHIND ALL FIRE HYDRANTS.

TRACER WIRE INSTALLATION ON WATER SERVICE

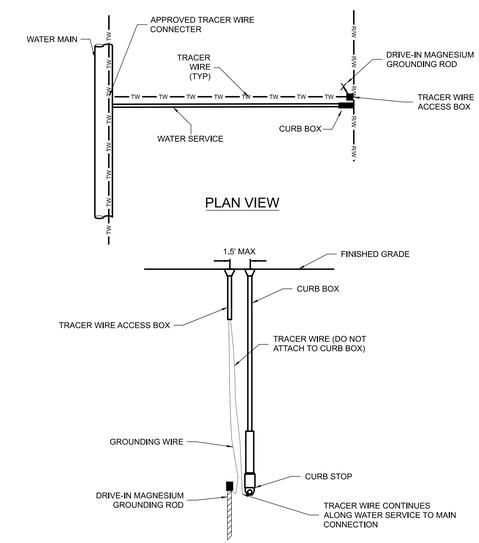

NOTES:

1. REFER TO SPECIFICATIONS FOR TRACER WIRE.
2. TRACER WIRE SHALL BE TAPED TO MAIN AND SERVICES. WIRE IS SHOWN OFF PIPES FOR CLARITY.
3. INSTALL GROUNDING ANODE BY DRIVING INTO VIRGIN GROUND AT THE CURB STOP.

STANDARD DETAIL SHEET
GENERAL

KENOSHA WATER UTILITY ENGINEERING SERVICES
Curt Czarnecki - General Manager
4401 Green Bay Rd. Kenosha, Wisconsin 53144-1716
ph (262) 653-4335

REVISIONS			
Survey By :	Date :		
Design By :	Date :		
Drawn By : AMD	Date : 01/29/24		
Checked By :	Date :		
ID. N. R. No. :	Date :		